


Permanent Underground Service (Meter Pole)



- Notes:**
1. All 125-volt, single-phase service outlets (receptacles) installed outdoors shall have ground-fault-circuit-interrupter protection for personnel.
 2. Other governing bodies such as counties, municipalities, etc. with legal jurisdiction; may enforce additional rules and regulations.
 3. Where local inspection authority is not involved, meter installations should be wired in accordance with the National Electrical Code or FEC Specifications when the FEC Specifications exceed those of the National Electric Code.

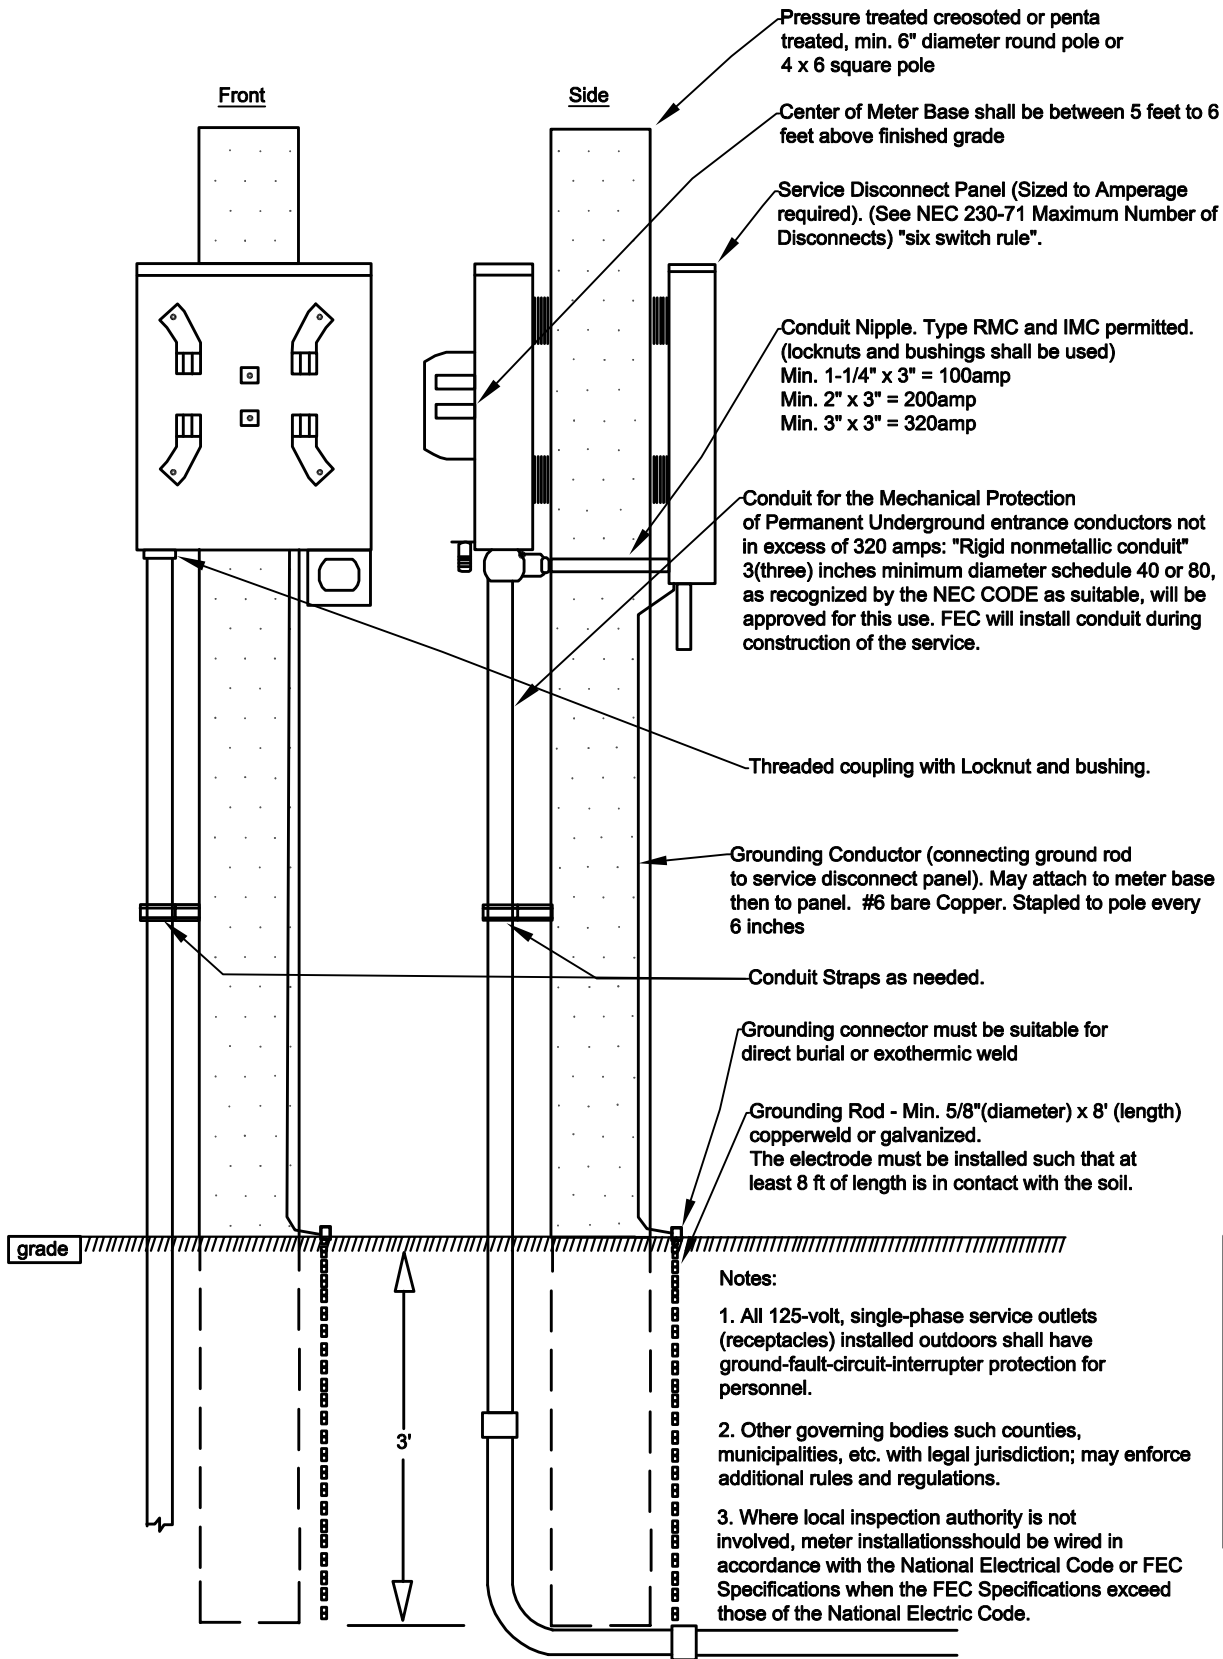